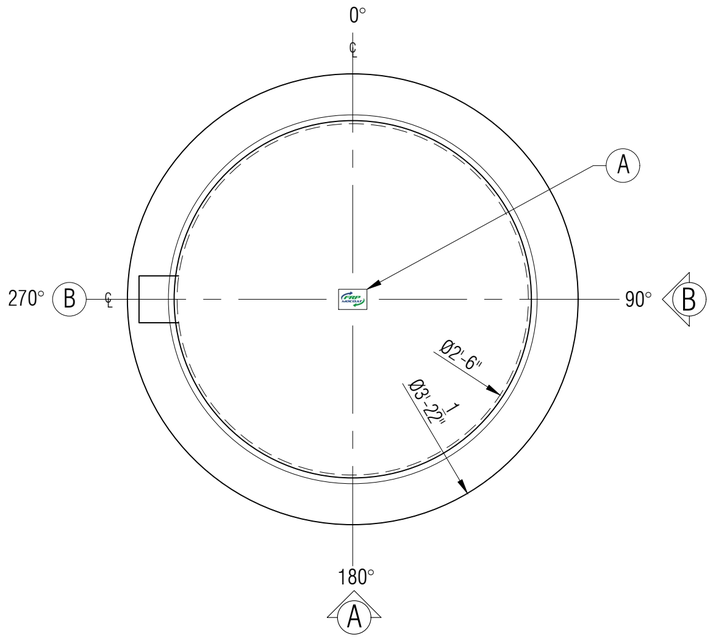

PLAN

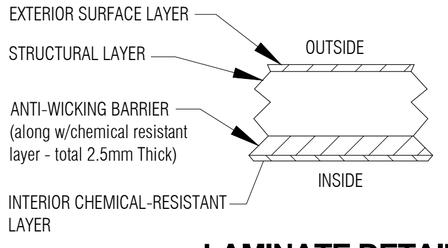

LAMINATE DETAIL 1

N T S

GENERAL NOTES:
- CSA B66 CERTIFIED FOR SEWAGE.
- TANK COMES UNASSEMBLED FROM FACTORY.
- TESTED TO 10'-0" BURIAL DEPTH.
- DIMENSIONS SHOWN IN FEET INCHES FORMAT OTHERWISE NOTED.
- 1/2" FABRICATION TOLERANCE. DOES NOT APPLY TO LAMINATE THICKNESS.

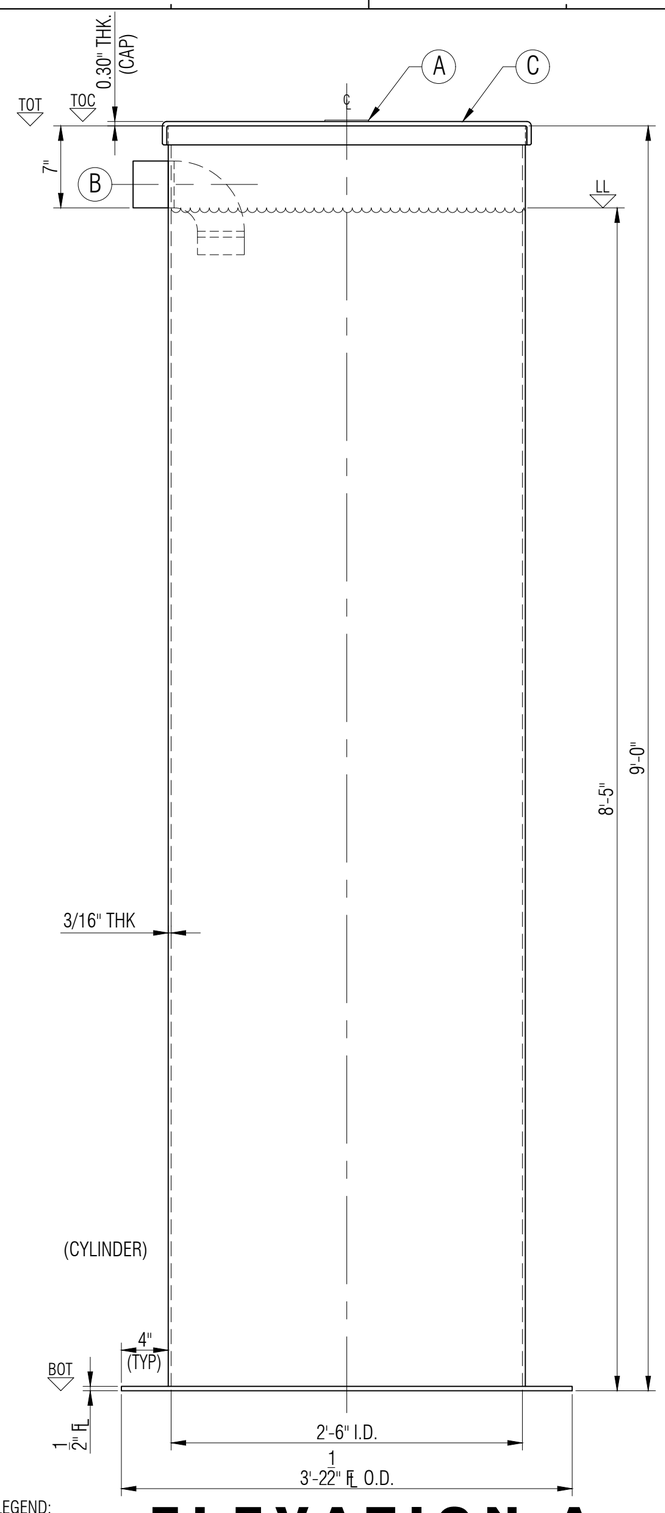

ELEVATION A

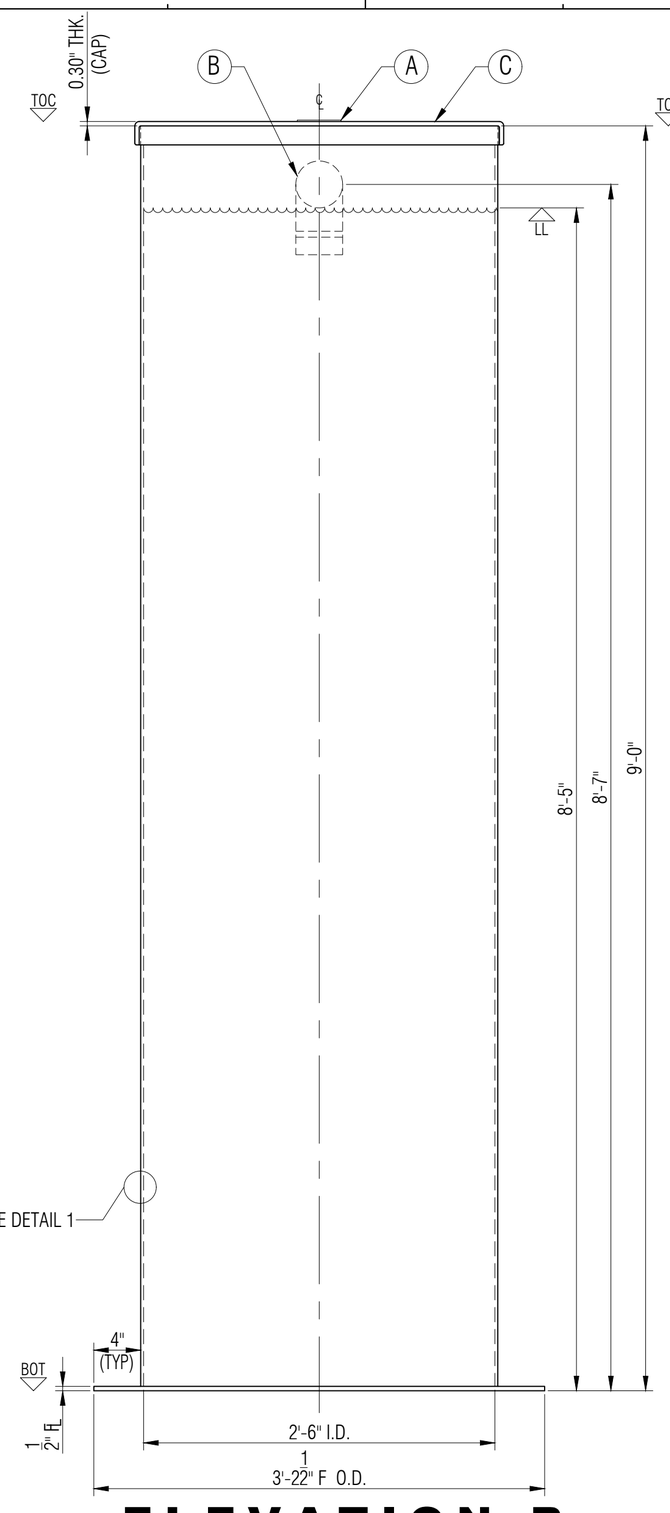

ELEVATION B

LEGEND:
TOL - TOP OF LID
TOC - TOP OF CAP
TOT - TOP OF TANK
BCD - BOLT CENTER DIAMETER
BOT - BOTTOM OF TANK
LL - LIQUID LEVEL
I/S - INSIDE
O/S - OUTSIDE
Ø - DIAMETER
° - DEGREE/S
TYP- TYPICAL
℄ - CENTER LINE
NTS - NOT TO SCALE

ITEM#	QTY	PART LIST/DESCRIPTION	APPROX. WEIGHT:	111 KG (245 LBS)
A	1	NAMEPLATE	OVERALL CAPACITY:	1,227L (270 IG/1,324 USG)
B	1	4"Ø PVC - INLET		
C	1	30"Ø DETACHABLE - CAP LID		
D				
E				
F				
G				

DRAWN:	ATF
CHECKED:	
DATE:	FEB. 21, 2024
DESIGNED:	
APPROVED:	MPS
MFG:	DS
PM:	GA
SALES:	DG

CLIENT: FRP/MOCOAT FIBERGLASS LTD.

TITLE: **HT30D108L FRP TANK**

FRPMOCOAT FIBERGLASS LTD.

SIZE	DRAWING NUMBER:	REVISION
C	HT30D108L	0

SCALE	EST#:	SO#:	SHEET
1:10	PO#:	JOB#:	1/1